


WATER


FILTER WATER

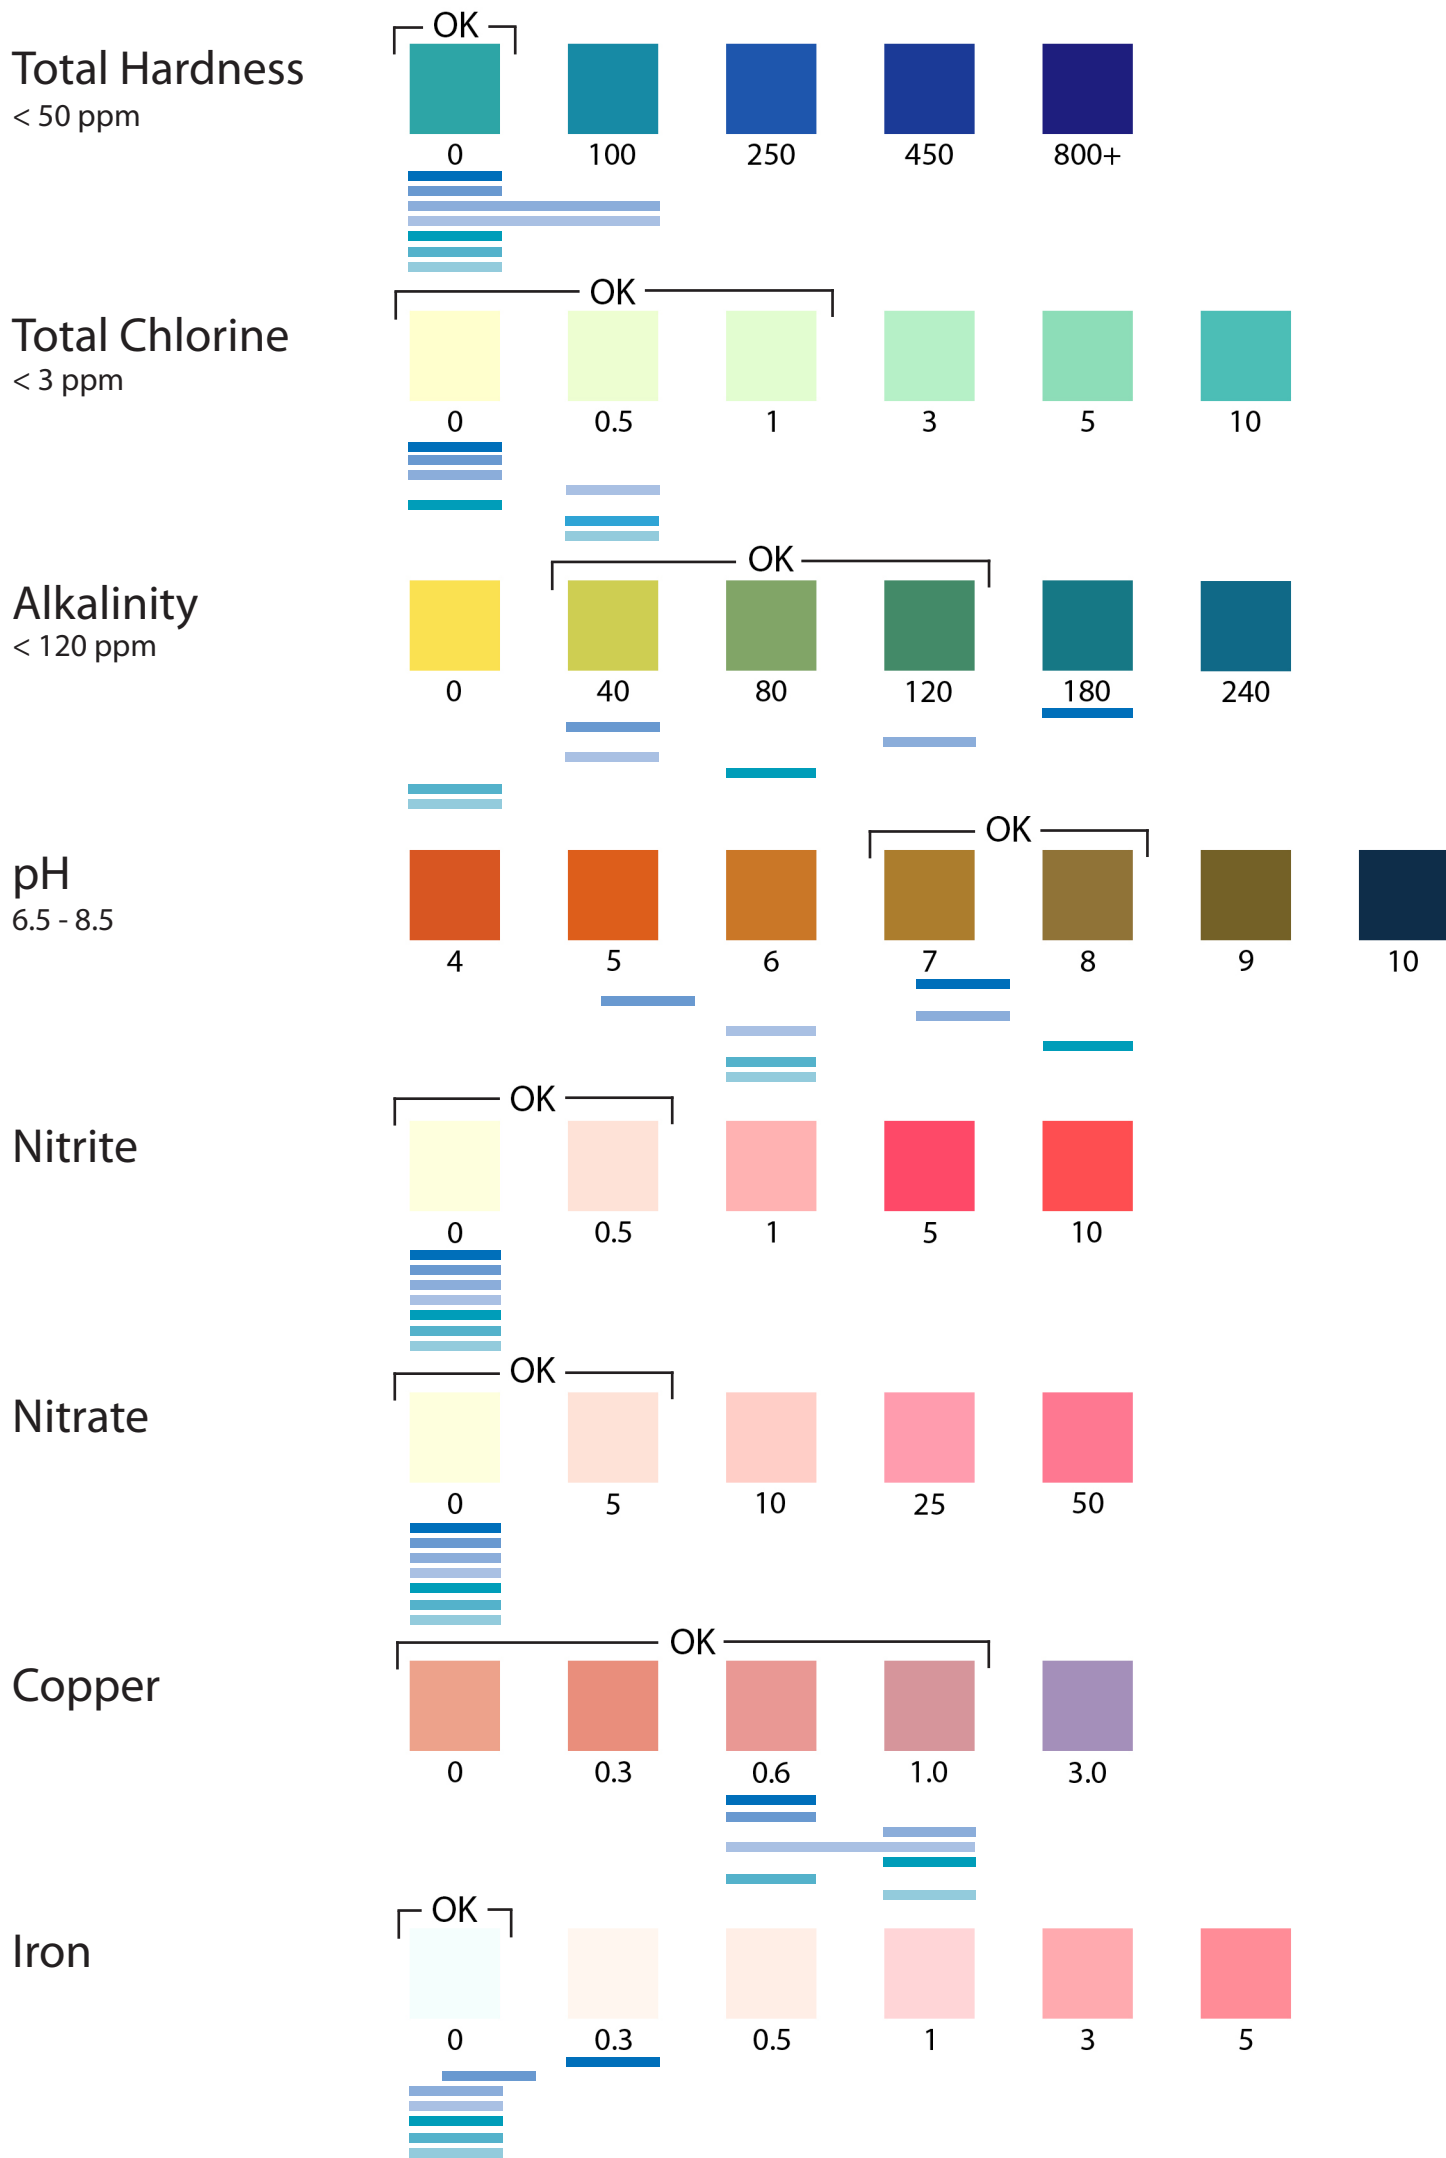

	Biloxi	Culver City	Denver	Las Vegas	Minneapolis	Phoenix	San Diego
Total Hardness (<50 ppm)	0	0	0 - 100	0 - 100	0	0	0
Total Chlorine (<3 ppm)	0	0	0	0.5	0	0.5	0.5
Alkalinity (<120 ppm)	180	40	120	40	80	0	0
pH (6.5 - 8.5)	7.5	5.5	7.5	6.0	8	6	6
Nitrite	Safe	Safe	Safe	Safe	Safe	Safe	Safe
Nitrate	Safe	Safe	Safe	Safe	Safe	Safe	Safe
Copper (ppm)	0.6	0.6	1	0.6 - 1.0	1	0.6	1
Iron (ppm)	0.3	0	0.1	0	0	0	0
Total Caliform Bacterial		Neg.				Neg.	
Pesticide		Neg.	Neg.	Neg.	Neg.	Neg.	
Lead		Neg.	Neg.	Neg.	Neg.	Neg.	

WATER

TAP WATER

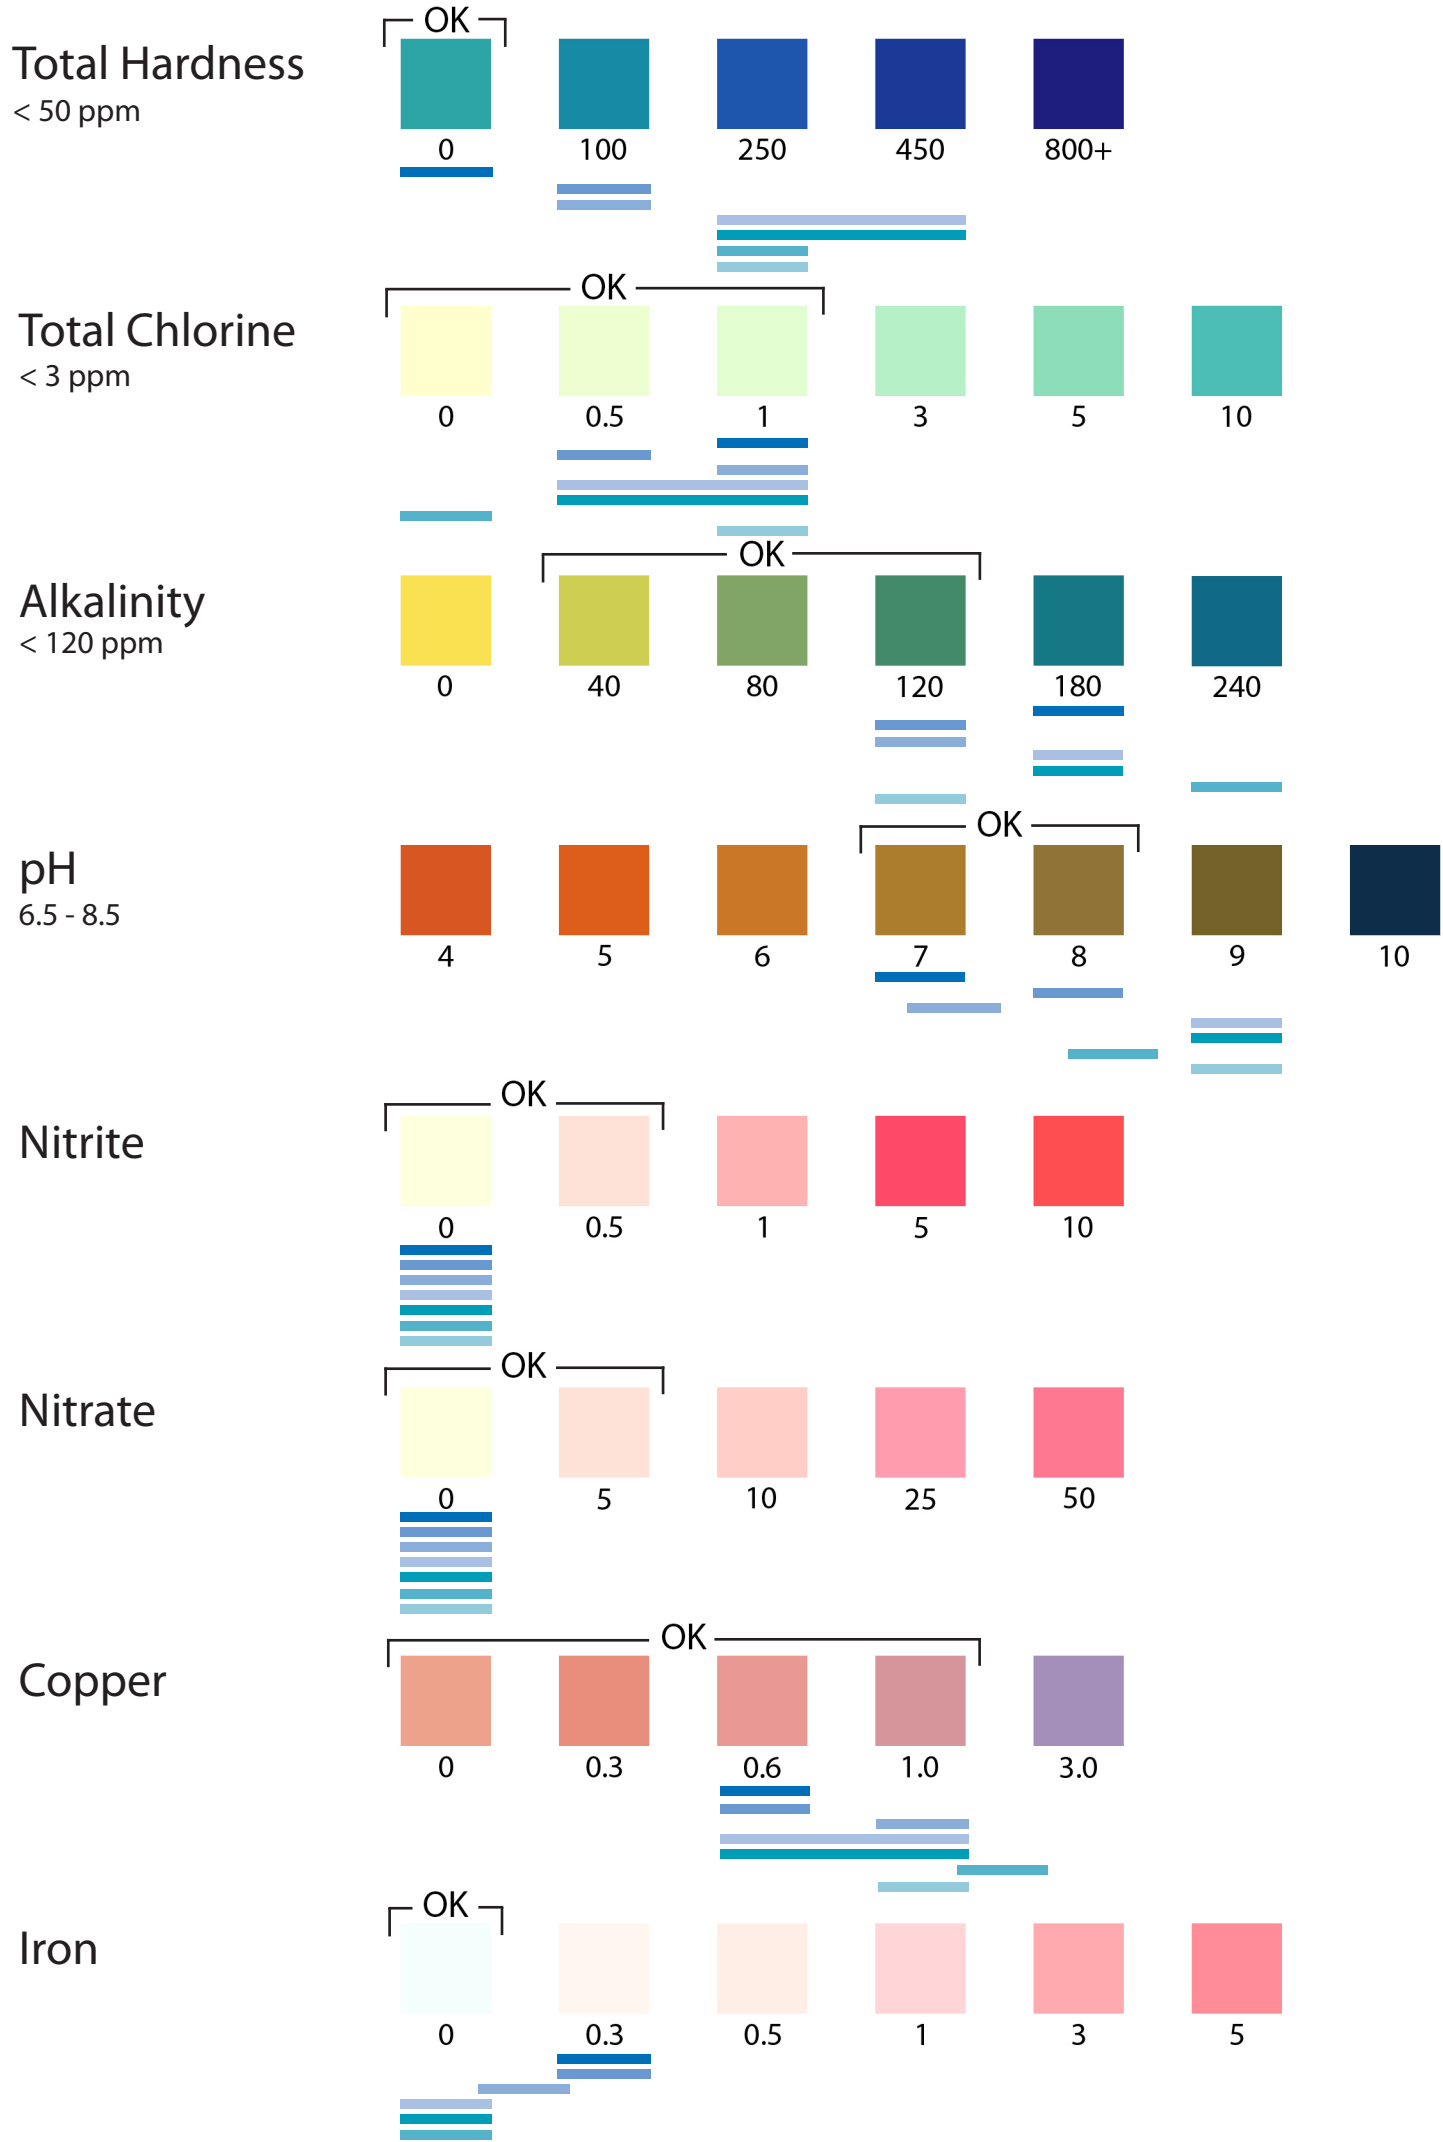

	Biloxi	Culver City	Denver	Las Vegas	Minneapolis	Phoenix	San Diego
Total Hardness (<50 ppm)	0	100	100	250 - 450	250 - 450	250	250
Total Chlorine (<3 ppm)	1	0.5	1	0.5 - 1.0	0.5 - 1.0	0	1
Alkalinity (<120 ppm)	180	120	120	180	180	240	120
pH (6.5 - 8.5)	8.5	8	7.5	9	7	8.5	9
Nitrite	Safe	Safe	Safe	Safe	Safe	Safe	Safe
Nitrate	Safe	Safe	Safe	Safe	Safe	Safe	Safe
Copper (ppm)	0.6	0.6	1	0.6 - 1.0	0.6 - 1.0	2	1
Iron (ppm)	0.3	0.3	0.2	0	0	0	N/A
Total Caliform Bacterial							Neg.
Pesticide	Neg.						Neg.
Lead	Neg.						Neg.